


Notes:

1. This drawing is for 'Dimensional information Only', it is essential that this drawing is read in conjunction with the 'Installation Guidelines' supplied with the unit.
(Copies available from our Sales Department)
2. Inlet and Outlet pipes are Ø110mm PVCu.
3. Extension neck kit is available for deer inverters up to a maximum invert of 2000mm. See extension neck drawing for assembly details.
4. Blower located inside external housing. Alarm beacon to be fitted to outside of blower housing (if applicable).
5. Vent pipe connection is supplied but vent runs and stacks are supplied by others.
6. Air hose for tank internals is supplied with blower housing and is run through the vent.
7. **Pea -shingle backfill is reliant on use of correct strapping and anchoring.

Unit Ref	A' (mm)	B' (mm)	C' (mm)	D' (mm)	E' (mm)	F' (mm)	G' (mm)	Unit Weight (Kgs)
BIA 6	500	600	4400	1920	2245	250	110	800
	1000	1100	4400	1920	2745	250	110	810
	1500	1600	4400	1920	3245	250	110	830
	2000	2100	4400	1920	3745	250	110	840

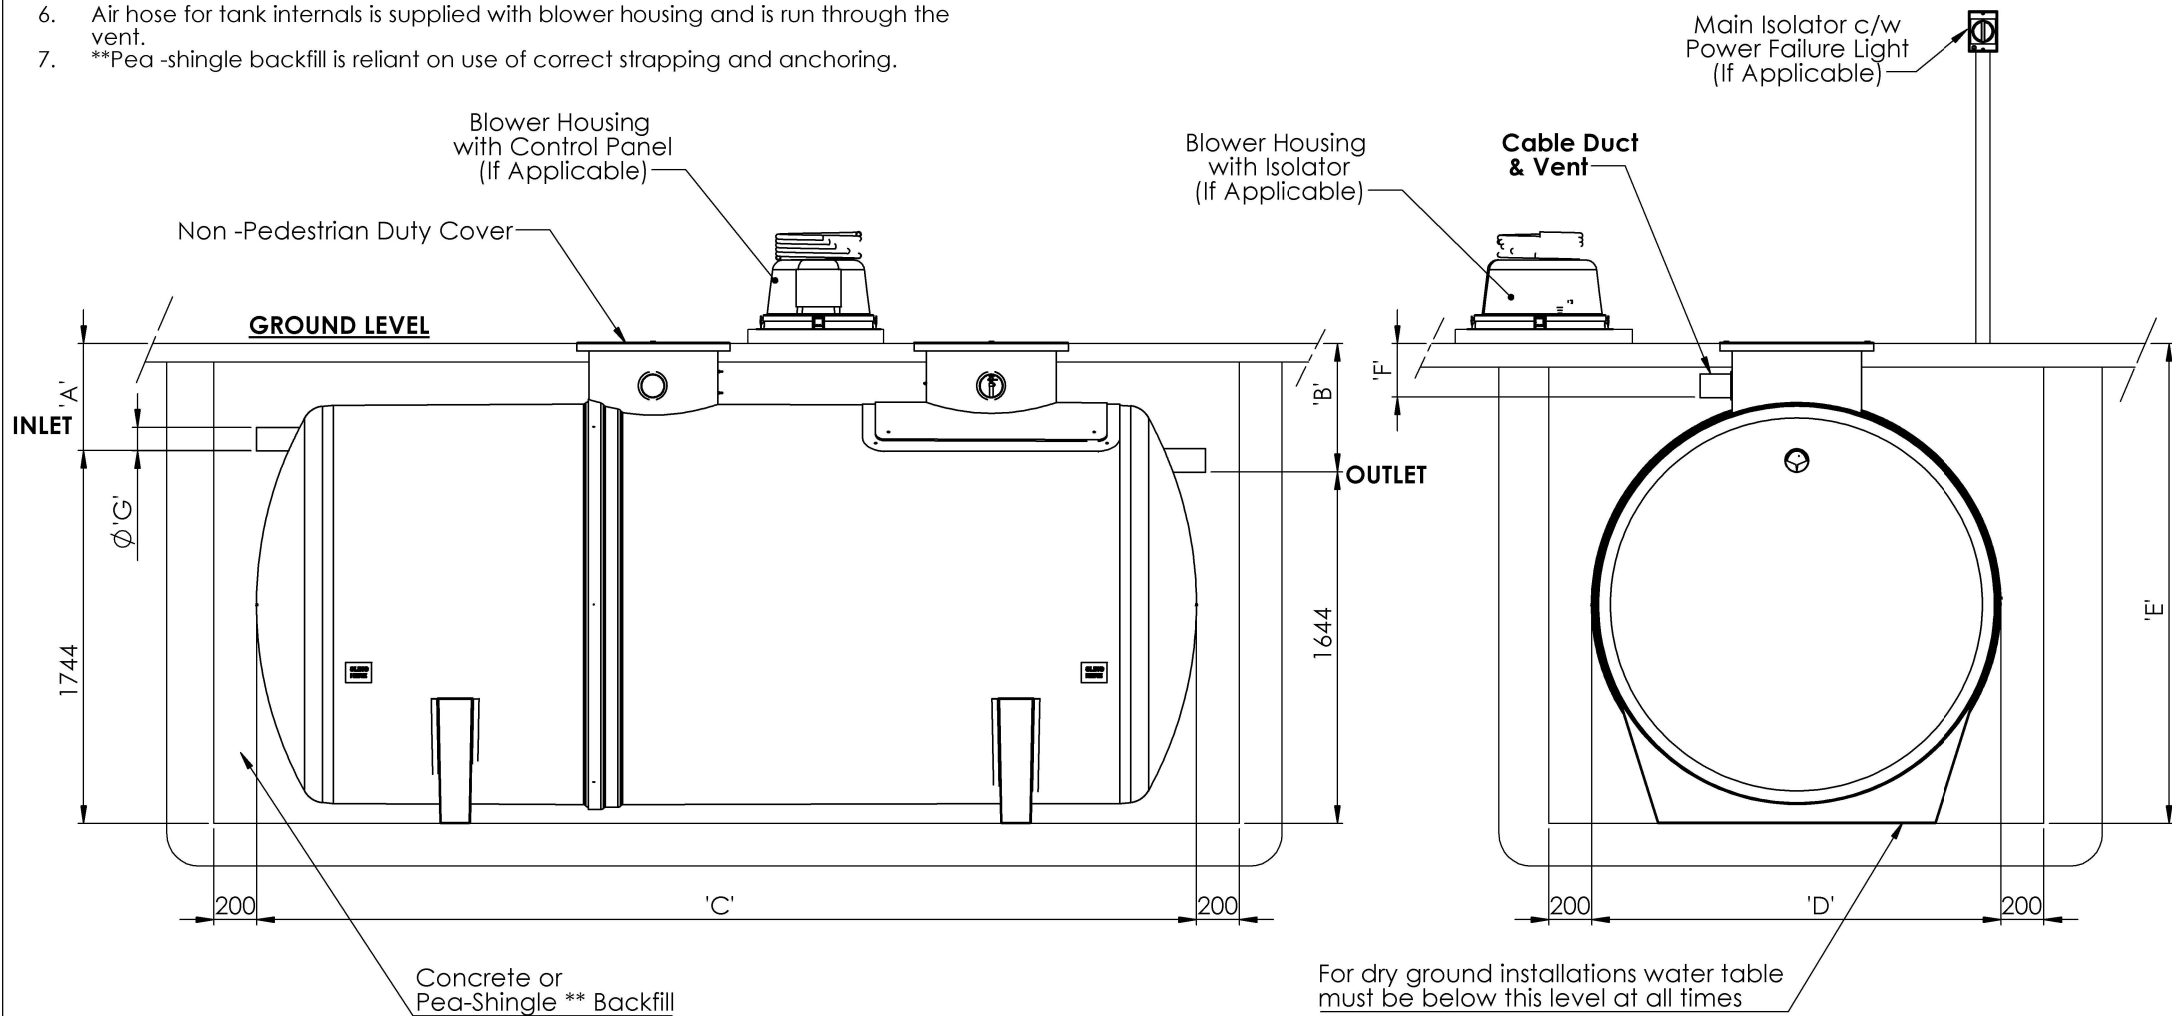

Please check with Kingspan Water & Energy for the latest Issue of the drawing

Issue	Date	Drawn By	Approved By	Description
01	12/05/23	D. Musvaburi	D.M	Initial Issue

Modelled By : D.Owen

Weight :
Material : Various

Tolerance (unless stated) : +/- 5 mm

Thickness : n/a
Surface Area : n/a m²


Drawing : DS1418P

Page 1 of 1

BioAir 6 Gravity (20PE) Sales Drawing

All Dimensions In mm

Scale: Do Not Scale



Third Angle Projection

Kingspan Water & Energy reserve the right to alter the details of this drawing without prior notice.
This drawing is copyright and may not be reproduced or used without the written permission of Kingspan Water & Energy

